


Air Compressor After-Cooler Control Wiring

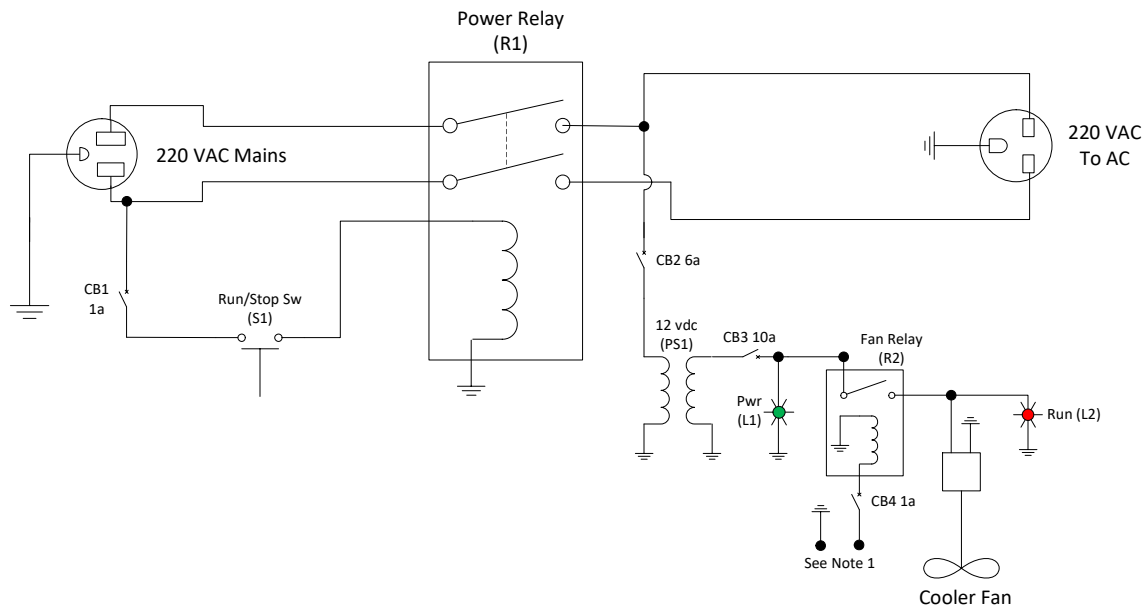

Notes:

- 1 – Connect to make side of AC pressure switch relay (110 VAC).
- CB3 is a DC circuit breaker. CB1,2,4 are AC circuit breakers.
- Control box housing select to suit.

Parts List

ITEM	QTY.	PART NO.	DESCRIPTION
CB1,4	2	1 amp	Din Rail mount AC circuit breaker
CB2	1	6 amp	Din Rail mount AC circuit breaker
CB3	1	10 amp	Din Rail mount DC circuit breaker
L1,2	2	12 VDC	LED panel light
PS1	1	12 VDC 15 amp	Switching Power Supply
R1	1	115vac 40 amp	Din Rail mount Contactor
R2	1	115vac 20 amp	Din Rail mount Contactor
S1	1	Start/Stop Sw	Emergency stop sw.

TITLE	DESCRIPTION		FILENAME
Control Box Wiring	After-Cooler Control Box Wiring		AC_AFTER-COOLER CONTROL.VSD
DRAWN BY	DATE	REVISED	PAGE
Steve Nance	7/19/2022		1 OF 1